Quick Guide



EE660 - Low Air Velocity Sensor with RS485 Interface

i PLEASE NOTE

Find this document and further product information on our website at www.epluse.com/ee660.

your partner in sensor technology.

Electrical Connection

⚠ WARNING

Incorrect installation, wiring or power supply may cause overheating and therefore personal injuries or damage to property. For correct cabling of the device, always observe the presented wiring diagram for the product version used.

The manufacturer cannot be held responsible for personal injuries or damage to property as a result of incorrect handling, installation, wiring, power supply and maintenance of the device.

Hardware

The bus termination shall be realized with 120Ω resistor using the switch on the electronics board.


NOTICE


Improper handling of the device may result in its damage.

The power supply must be strong enough to ensure supply voltage within the specified range (see technical data) at any time and at all devices in the bus. This is particularly relevant when using long and thin cables as those can cause high voltage drop. Please note that a single EE660 requires peak current of 150 mA.

Wiring

Digital interface



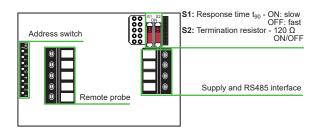

Address Setting

Address Switch



Address setting via PCS10 Product Configuration Software

All DIP switches at position $0 \rightarrow$ address has to be set via PCS10.

Modbus (slave device): factory setting 65 (permitted values: 1...247).

BACnet (master device): factory setting 65 (permitted values: 0...127).

Example: Address is set via configuration software = factory setting.



Address setting via DIP switch

Modbus (slave device): Setting the DIP switches to any other address than 0, overrules the Modbus address set via PCS10 (permitted values: 1...247).

BACnet (master device): Setting the DIP switches to any other address than 0, overrules the BACnet address set via configuration software.

BACnet Note: permitted values are 0...127. The 8th bit of the DIP switches is ignored. (ID 127 = 0111 111). To set address 0 via DIP switches, the 8th bit shall be set to 1 (ID 0 = 1000 0000). Example: Address set to 11 (= 0000 1011 binary).

BACnet Setup

Please refer to PICS (Product Implementation Conformance Statement), available on www.epluse.com/ee660.

Modbus Setup

FLOAT32

Parameter	Unit ¹⁾	Register number ²⁾ [DEC]	Register address ³⁾ [HEX]		
Read register: function code 0x03/0x04					
Temperature	°C	1003	3EA		
Temperature	°F	1005	3EC		
Air velocity	m/s	1041	410		
Air velocity	ft/min	1043	412		

INT16

Parameter	Unit ¹⁾	Scale ⁴⁾	Register number ²⁾ [DEC]	Register address ³⁾ [HEX]		
Read register: function code 0x03/0x04						
Temperature	°C	100	4002	FA1		
Temperature	°F	50	4003	FA2		
Air velocity	m/s	100	4021	FB4		
Air velocity	ft/min	1	4022	FB5		

¹⁾ The choice of measurement units (metric or non-metric) must be done according to the ordering guide, refer to EE660 datasheet. Switching from metric to non-metric or vice versa by using the PCS10 is not possible.

2) Register number (decimal) starts from 1. 3) Register address (hexadecimal) starts from 0.

⁴⁾ Examples: For scale 100, the reading of 2550 means a value of 25.5. For scale 50, the reading of 2550 means a value of 51.

8

Communication settings (INT16)

Parameter	Register number" [Dec]	Register address ² [Hex]	Size			
Write register: function code 0x06						
Modbus address ⁴⁾⁵⁾	1	00	1			
Modbus protocol settings ⁴⁾	2	01	1			
Device information (INT16)						
Parameter	Register number ¹⁾ [Dec]	Register address ²⁾ [Hex]	Size ³⁾			
Read register: function code 0x03/0x04						
Serial number (as ASCII)	1	00	8			

- 1) Register number starts from 1. 2) Protocol address starts from 0. 3) Number of registers.
- 4) For Modbus address and protocol settings refer to Application Note Modbus AN0103 (available at www.epluse.com/ee660).

10

5) If the ID is set via DIP-Switch the response will be NAK.


EE660 - Low Air Velocity Sensor with Analogue Output

Wiring

Firmware version

Sensor name (as ASCII)

Voltage output 0-10 V




Remote probe



80

09


Current output 4-20 mA

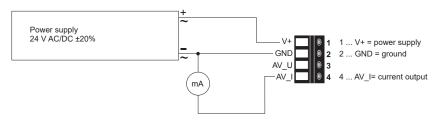

Jumper Settings

For performing the EE660 settings via the PCS10 Product Configuration Software (free download from www.epluse.com/pcs10) the jumper for the measuring range must be set to HI.



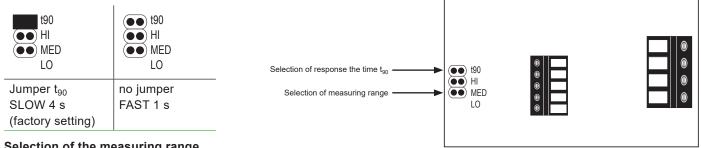

Selection of the measuring range

HI MED LO	t90 HI MED LO	t90 HI MED LO
Jumper HI 02 m/s (0400 ft/min) (factory setting)	Jumper MED 01.5 m/s (0300 ft/min)	no jumper 01 m/s (0200 ft/min)

E+E Elektronik Ges.m.b.H.

Langwiesen 7 4209 Engerwitzdorf | Austria T +43 7235 605-0 F +43 7235 605-8 info@epluse.com www.epluse.com





